

THE STATE



OF WYOMING



**JIM GERINGER**  
GOVERNOR

## Department of Environmental Quality

Herschler Building • 122 West 25th Street • Cheyenne, Wyoming 82002

ADMINISTRATION (307) 777-7758 FAX 777-7682	ABANDONED MINES (307) 777-6145 FAX 634-0799	AIR QUALITY (307) 777-7391 FAX 777-5616	INDUSTRIAL SITING (307) 777-7368 FAX 777-6937	LAND QUALITY (307) 777-7756 FAX 634-0799	SOLID & HAZARDOUS WASTE (307) 777-7752 FAX 777-5973	WATER QUALITY (307) 777-7781 FAX 777-5973
--	---	---	---	--	---	---

April 8, 1998

Norwesco  
Attn. Anastasia R. O'Hara  
P.O. Box 439  
St. Bonifacius, MN 55375-0439

RE: APPROVAL of 1000, 1250, and 1500 gallon Two Compartment Polyethylene Septic Tanks for use in Wyoming.

Dear Ms. O'Hara:

The Water Quality Division (WQD) of the Wyoming Department of Environmental Quality (DEQ) has received and reviewed the specifications for your 1000, 1250, and 1500 gallon two compartment polyethylene septic tanks. The WQD finds that these septic tank designs meet the minimum requirements as identified in Chapter 11, Section 39 of the Water Quality Rules and Regulations, except for one condition which must be imposed. Subsequently, these products will be placed on our list of approved septic tanks for use in Wyoming with the following condition:

"The manways on the septic tanks (one on each compartment) must be extended to the ground surface because there are no clean-outs provided on the Norwesco septic tanks."


Sincerely;

Ronald L. Ewald  
Engineering Evaluator  
SE District, Water Quality Division




RLE:LL#81183

cc: Septic Tank Status File  
Larry Robinson, SPO Program Manager, WQD  
Lou Harmon, SE District Engineering Supervisor, WQD  
Don McKenzie, NE District Engineering Supervisor, WQD  
Jeff Hermansky, NW District Engineering Supervisor, WQD  
Randy Taylor, SW District Engineering Supervisor, WQD

REVISIONS				
ZONE	REV	DESCRIPTION	DATE	APPROVED
	C	REDRAWN, DIMS UPDATED	17FEB97	

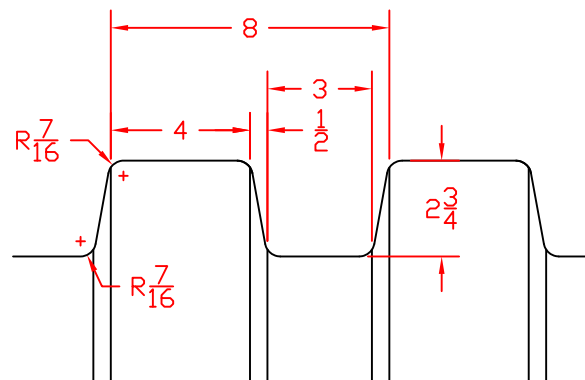




RIB DETAIL 1/4 SCALE

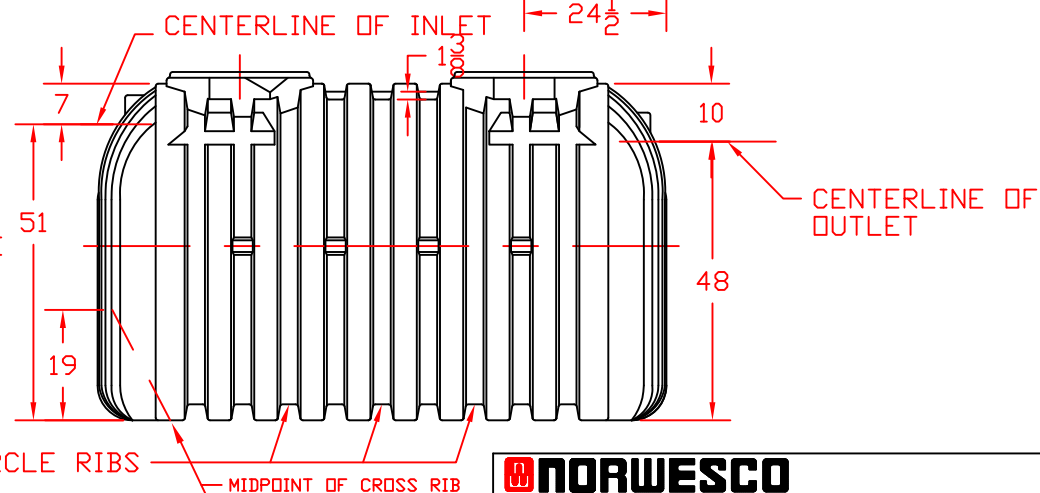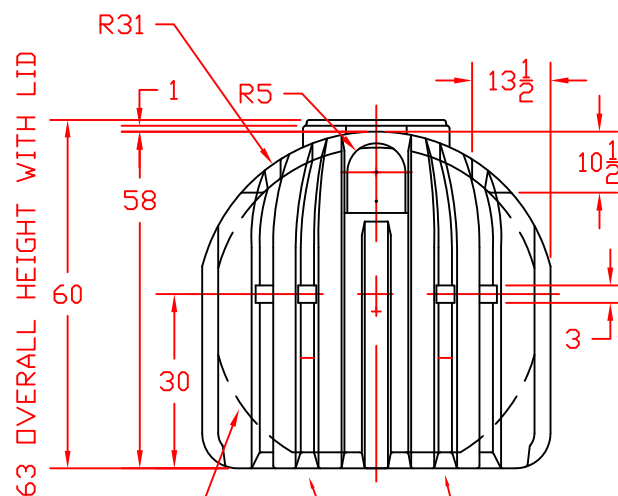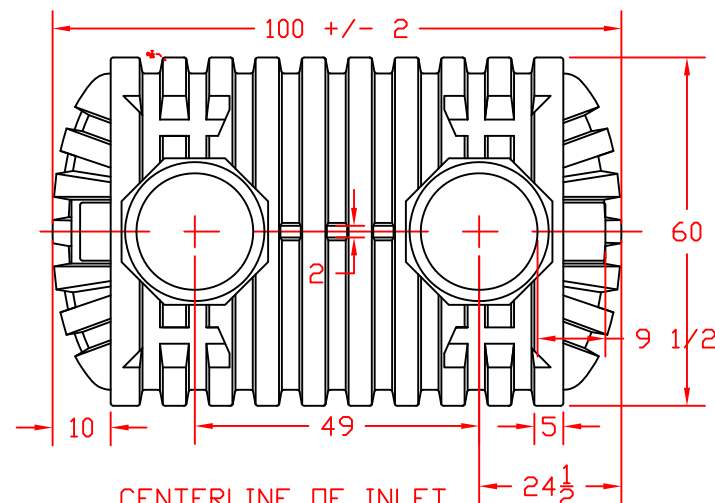

**NORWESCO**  
ST. BONIFACIUS, MN  
1000 GALLON SEPTIC TANK

JTP	17FEB97	SIZE B	FSCM NO.	DWG NO.	REV C
SCALE 1/24		SHEET 1 OF 2			

REVISIONS				
ZONE	REV	DESCRIPTION	DATE	APPROVED

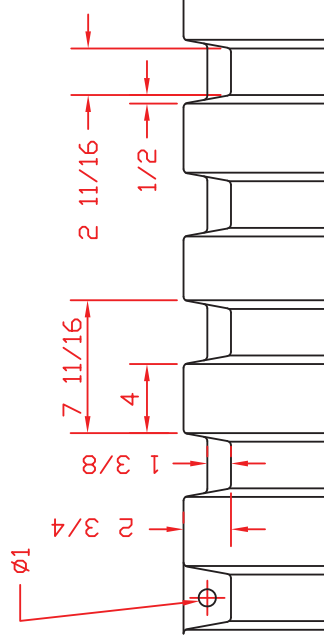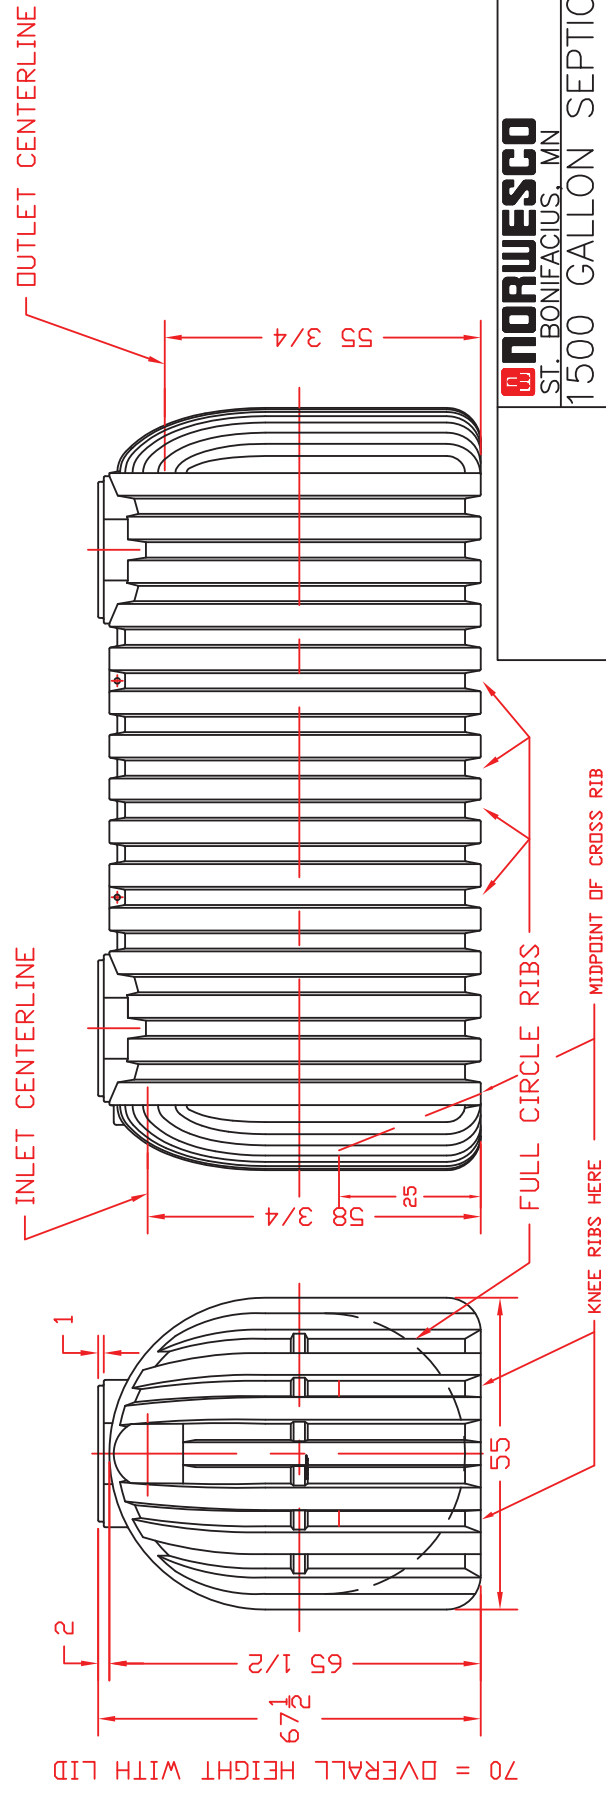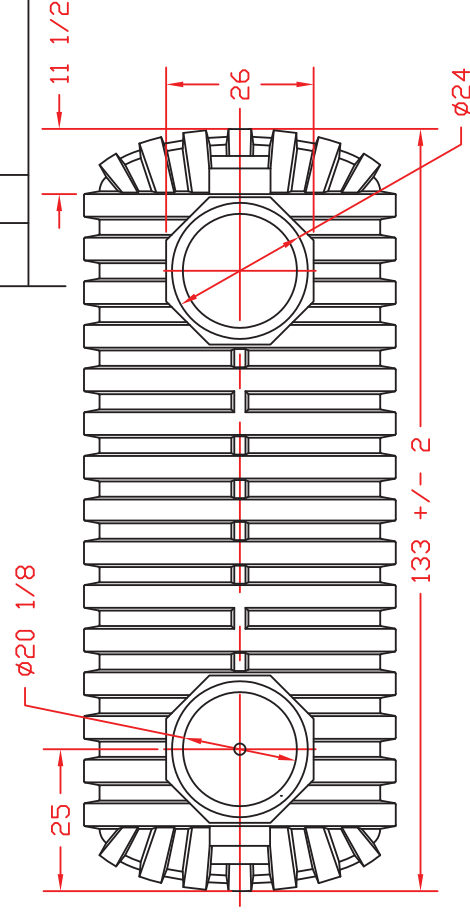RIB DIMENSIONS  
1/8 SCALE

1500 GALLON SEPTIC TANK

JTP 18MAY00	SIZE	FSCM NO.	DWG NO.	REV
	B			
SCALE 1/24			SHEET	

SCALE 1/24	SHEET
------------	-------